



# Air Cooling Energy Storage System

## TRENE-P100B215I Installation Manual

Version 5.0

[www.solaxpower.com](http://www.solaxpower.com)



©Manual in the UK code or at  
<http://kb.solaxpower.com/>



# Table of Contents

---

Safety..... 1

Installation..... 8




















## General Notice

1. Contents may be periodically updated or revised. SolaX reserves the right to make improvements or changes in the product(s) and the program(s) described in this manual without the prior notice.
2. The installation, maintenance and grid-related setting can only be performed by qualified personnel who:
  - Are licensed and/or satisfy state and local jurisdiction regulations;
  - Have good knowledge of this manual and other related documents.
3. Before installing the device, carefully read, fully understand and strictly follow the detailed instruction of the user manual and other related regulations. SolaX shall not be liable for any consequences caused by the violation of the storage, transportation, installation, and operation regulations specified in this document and the user manual.
4. Use insulated tools when installing the device. Individual protective tools must be worn during installation, electrical connection and maintenance.
5. Please visit the website [www.solaxpower.com](http://www.solaxpower.com) of SolaX for more information.

## Safety Instruction

For safety reasons, installers are responsible for familiarizing themselves with the contents of the Manual and all warnings before performing installation.

## Descriptions of Labels

	CE mark of conformity		TUV certification
	RCM mark of conformity		Grounding point
	Additional grounding point		Caution, risk of danger
	The battery module may explode.		Caution, risk of electric shock
	Caution, hot surface		Do not operate this system until it is isolated from mains and battery suppliers.
	Read the enclosed documentations.		Keep the system away from children.
	Keep the system away from open flames or ignition systems.		Do not dispose of the device together with household waste.
	The system must be disposed of at a proper facility for environmentally-safe recycling.		Wait for 60 minutes after disconnecting the power to ensure the PCS is fully discharged.
	Danger of high voltage. Do not touch live parts in the cabinet for 15 minutes after disconnection from the power sources.		

 DANGER!

- According to the local laws and regulations related to high-altitude work, operators must wear PPE, e.g., a helmet, safety belt, or waist harness, when they work at heights, while the other end of the harness must connect to a secure structure to prevent fall incidents.

 DANGER!

- Do not connect the positive and negative poles of a battery together. Otherwise, it may be short-circuited. This will result in an excessive flow of current and large quantities of energy for a short time, and then will cause battery leakage, smoke, the emission of flammable gases, thermal runaway, fire, or even an explosion. Therefore, the battery must be powered off before maintenance.
- If a battery is overheated, it will cause leakage, smoke, release of flammable gases, thermal runaway, fire, or even an explosion. Therefore, please ensure that the installation site shall be well ventilated and kept away from high temperatures.
- Do not dismantle, change, shake, drop, crush, impact, cut, penetrate with a sharp object, or any other ways to damage the battery. Otherwise, it may cause leakage, smoke, emission of flammable gases, thermal runaway, fire, or even an explosion.
- Do not mix different types or makes of the battery. Otherwise, it may cause leakage or rupture, resulting in personal injury or property damage.
- The battery electrolyte is toxic and volatile. Never get in contact with the leaked liquids or inhale gases in the case of the battery leakage or odor, and contact professionals immediately. The professional must wear PPE (including but not limited to safety glasses, safety gloves, gas masks, and protective clothing) before powering off the device, and then contact our company at once after removing the damaged battery.
- Normally, the battery will not release any gases. However, in the following situations: burnt, needle-pricked, squeezed, struck by lightning, overcharged, or subject to other adverse conditions that may cause battery thermal runaway, the battery may be damaged or an abnormal chemical reaction may occur inside the battery, resulting in electrolyte leakage or production of gases. If the battery needs to exhaust flammable gas, safe emission measures must be taken to prevent fire and device corrosion.
- Do not use damaged batteries, and ensure that the installation site must be well ventilated.

 DANGER!

- Only operate the PCS if it is in a technically faultless condition. Operating a faulty PCS may lead to electric shock or fire.
- Do not attempt to open the enclosure without authorization from SolaX. Unauthorized opening of the enclosure will void the warranty and can result in lethal danger or serious injury due to electric shock.
- Make sure that the PCS is reliably grounded before any operation to prevent the risk of electric shock causing lethal danger or serious injury.
- Only qualified personnel can perform the installation, wiring, maintenance of the PCS by following this document and the related regulations.

 **DANGER!**

- Please make sure that the unit is free from any damage before the electrical connection.
- Do not modify, change, or dismantle the device, do not change the power-on and power-off sequences and the installation procedure written in the document, and please properly and correctly operate it.
- Do not power on the device during installation. Otherwise, it may cause a fire, personal injury, or device damage.
- Must remove earrings, rings, bracelets, watches, and any other metal jewelry before operation, to avoid electrical shock, burns, or even death.
- During operation, special insulated tools must be used to avoid electric shock or short circuit failure. The insulated tools' voltage ratings must exceed the system voltage ratings. Please refer to "12 Technical Data" for system information.

 **WARNING!**

- Please prepare tools that meet the requirements before installation, and check the number of tools after installation, to avoid leaving them inside the equipment.
- Please ensure that the cabinet has been thoroughly secured before operating it. Otherwise, it may cause personal injury or equipment damage due to tilting or collapsing the cabinet.
- Please ensure that the cabinet's vents and cooling system are working properly when it is running. If the vents are blocked, it will lead to overheating, and even equipment damage or fire hazard.
- Please ensure that the cabinet's vents and cooling system are kept away from heat sources.
- Do not drill holes in the device to avoid equipment failure.
- If the circumstances that may cause personal injury or equipment failure occur, such as, fluid flowing into the equipment, stop operation and power off immediately. Otherwise, it may cause a short circuit or damage.
- Do not open the cabinet doors on a rainy or high humid day ( $\geq 80\%$  humidity). If the doors have to be opened on such days, please take proper protective measures.

 **WARNING!**

- Please read the document carefully before installation, operation and maintenance.
- Must arrange fire-fighting equipment in advance according to the local laws, regulations, and standards while installing and commissioning the device.
- Please check that there is no damage to the outer packaging before and after unpacking, and in the process of storage and transportation. The battery shall be correctly placed or stacked in accordance with the requirements stipulated on the labels to prevent damaging or scrapping the battery resulting from crushing or falling.
- Must tighten screws securing cables and on the copper bars according to the torque information specified in the document, and check whether they are tightened periodically. For instance, whether there is any rust, corrosion, or any other foreign object on it, and then clean it up if any. Because the loose screw connections may result in excessive voltage drops and large currents, leading to generating a lot of heat and burning the battery.

 **WARNING!**

- The battery should be charged in time after discharge, to prevent battery damage due to overdischarge. If a battery pack is stored for a long time, please periodically recharge it to protect it from damage according to the storage requirements specified in the document.
- Please charge the battery within the specific temperature range because the low temperature may result in a short circuit. Hence, do not charge it when the temperature is below the low limit of the operating temperature.
- Do not use the battery when you find a bulge, or dents on the battery housing, and contact the installer or professional maintenance personnel to dismantle and replace it. The damaged battery must be kept away from other devices and flammable and explosive articles, and do not contact it except for professionals.
- Before operation, ensure that there are no irritating or burning smells around the battery.
- Do not weld or grind near a battery. Because electric sparks or arcs may cause fires.
- Do not step, lead, stand, or set on the battery.

 **WARNING!**

- Operators must wear PPE while installation and maintenance of the device.
- During operation, avoid touching any parts of the PCS other than the LED panel.
- Never connect or disconnect the AC and DC connector while the PCS is running.
- Prior to conducting any maintenance, turn off the AC and DC power and disconnect them from the PCS. Wait for 15 minutes to fully discharge the energy.
- Avoid touching the PCS while it is running, as it becomes hot during operation and may cause personal injuries.

 **WARNING!**

- Please wear PPE, such as, protective clothing, insulating shoes, goggles, safety helmets, insulating gloves, etc., when conducting electrical wiring.
- Do not touch the power supply equipment directly, or through conductors or damp objects.
- Do not touch the parts of the equipment of which warning signs are attached, to avoid personal injury or device damage.

 **CAUTION!**

- Do not use a straight ladder. When electrical work is involved, a wooden ladder or an insulated ladder shall be used.
- The equipment shall not be used to provide a backup power source in the following circumstances:
  - a. Equipment related to life;
  - b. Sensitive precision instruments;
  - c. Home appliances will be faulty in the case of a power failure during operation.



 CAUTION!

- Do not power on the device until it has been installed and confirmed by professionals.
- In the event of a fire, evacuate immediately and call the local fire services.

NOTICE!

- The signs and messages on the labels and nameplates attached to the device need to be visible and clear.

NOTICE!

**Transportation requirements for battery:**

- Relevant qualifications for the transport of dangerous goods must be obtained by the forwarding agent engaged in such businesses, and they must strictly abide by the local regulations for the transport of dangerous goods.
- Please check the battery before transportation. If a battery leaks, smells, or is damaged, do refuse to transport it.
- Please handle gently in the process of loading and unloading, transportation, and moving a battery to prevent bumping, and take effective moisture-proof measures to prevent personal injuries and battery damage.
- Unless otherwise specified, do not transport the batteries, which are classified as dangerous goods, together with food, medicine, or other additives on the same means of transport.

**If the battery leaks electrolyte or any other chemical materials, the electrolyte leakage can lead to toxic gases. Therefore, do not contact with them at all times. In case of accidentally coming into contact with them, please do as follows:**

- In case of inhalation: Leave the contaminated area immediately, and seek medical attention at once;
- In case of contact with eyes: Rinse eyes with running water for at least 15 minutes, and seek medical attention;
- In case of contact with skin: Wash the contact area thoroughly with soap, and seek medical attention;
- In case of ingestion: Induce vomiting, and seek medical attention.

**If a fire breaks out where the battery is installed, please do as follows:**

- In case a battery is charging when the fire breaks out, provided it is safe to do so, press the emergency stop button and unplug the power cable;
- In case a battery is not on fire yet, use a water-based fire extinguisher or a carbon dioxide extinguisher to extinguish the fire;
- In case a battery catches fire, do not try to put it out, and evacuate immediately;
- A battery may catch fire when it is heated above 150°F/60°C. If the battery catches fire, please evacuate immediately since it will generate noxious and poisonous gases.

## NOTICE!

**Recovery of damaged or wasted battery:**

- Dispose of the damaged or wasted batteries according to local laws and regulations instead of placing them in the household trash or curbside recycling bins. Otherwise, it may cause environmental pollution or explosions.
- Ensure that the damaged or wasted batteries are not exposed to the following situations: high temperatures, high humidity, direct sunlight, or corrosive environments.
- Contact a battery recycling company to scrap the battery, which leaks electrolytes, or is damaged or expired.
- Please take protective steps to prevent battery short circuits before moving batteries.
- Please keep away from flammable material storage areas, residential areas, and other population centers when transporting and storing the damaged battery.

## NOTICE!

- Only connect the PCS to the grid with the permission of the local utility grid company.

## NOTICE!

- Please operate according to the safety code for power station.
- Before installation, it is necessary to set up temporary safety fences or warning lines and hang warning signs in the operation area, to prohibit non-staff from entering here.
- Please make sure that the equipment and its associated switches are off before connecting and disconnecting power cables.
- Please check whether the protective housing and insulating sleeve for an electrical component have been installed correctly after finishing installation, to avoid electric shock.
- Must turn off the output switch of the power supply equipment when maintaining its electrical terminal device and power distribution device.
- If the device is required to be powered off during troubleshooting and diagnosis, please do as the following procedure: power off > electricity testing > connecting grounding cable > hanging warning signs and setting up guardrails.
- Must hang up "Do Not Switch On" warning signs on the relevant switches or circuit breakers before completing maintenance, to prevent power connection. Do not switch on before the fault is solved.
- Do not use water, alcohol, oil, or other solvents when cleaning electrical components inside and outside the device.

## NOTICE!



















### Grounding Requirements:

- The device's grounding impedance shall meet the requirements of local electrical safety standards.
- The equipment shall be permanently connected to a grounding wire within the building's electrical system. Please check whether the device is reliably grounded before operation. The grounding cable should be removed last while dismantling and maintaining the device.
- Do not start the device if it is not fitted with a grounding conductor.
- All acts against the grounding conductor are prohibited.
- If the device is equipped with a three-pronged socket, make sure that the ground prong is reliably grounded.
- For the device that may generate large contact currents, please make sure that the grounding terminal on the housing has been grounded before powering on, to avoid electric shock.







### Cable Requirements:

- When deciding the wire diameter, and connecting or wiring cables, follow the local laws, regulations, and codes to ensure safety.
- When external conditions (e.g., placement method, ambient temperature, etc.) change, the cable type must be verified according to IEC-60364-5-52 or local laws, regulations and standards. For instance, whether the cable's current-carrying capacity meets the requirements.
- Before connecting power cables, please make sure that the cable labels are correctly labelled and the cable terminals are well insulated.
- Do not loop and twist cables while conducting electrical wiring. If the length of the power cable is not enough, please replace it instead of joining or welding. Ensure that all the cables of the correct type and size are fully connected and well insulated, and the edges of cable slots and crossing holes are smooth.
- It is recommended to bundle similar cables with cable ties, to ensure that the inside of the device is neat and tidy and to avoid cable jacket damage.
- Please use fireproof mud to seal the threading openings immediately after finishing wiring, to avoid the entry of water vapour or small animals.
- Cables should be kept away from heaters or other heat sources, because a high temperature environment may result in aging and damage to cable insulation.

# Packing List




## Installation Site




Installation Site	Distance
Distance from coastal areas	> 2000 m
Distance from heavy pollution sources, such as smelters, coal mines, thermal power plants	> 1500 m
Distance from moderate pollution sources, such as chemical plants, rubber plants, and electroplate factory	> 1000 m
Distance from light pollution sources, such as food processing plants, leather processing plants, heating boiler factory, slaughter houses, dumping sites, and sewage treatment stations	> 500 m

## Transportation Requirement


### Forklift Requirement

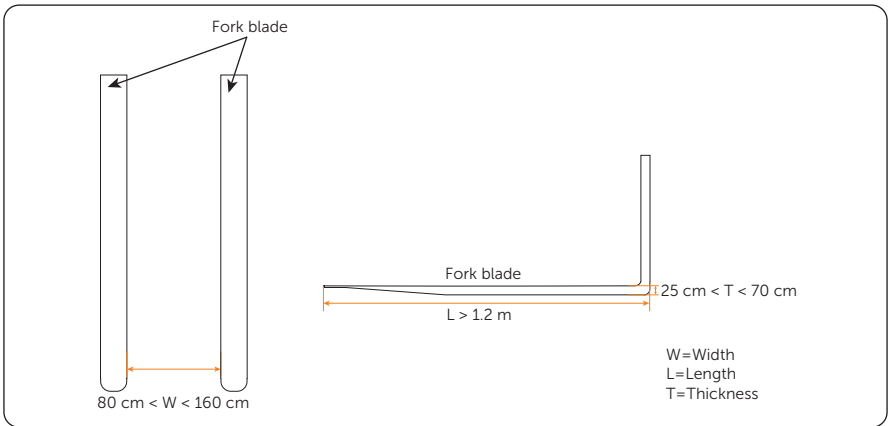

### Carton Fork Holes

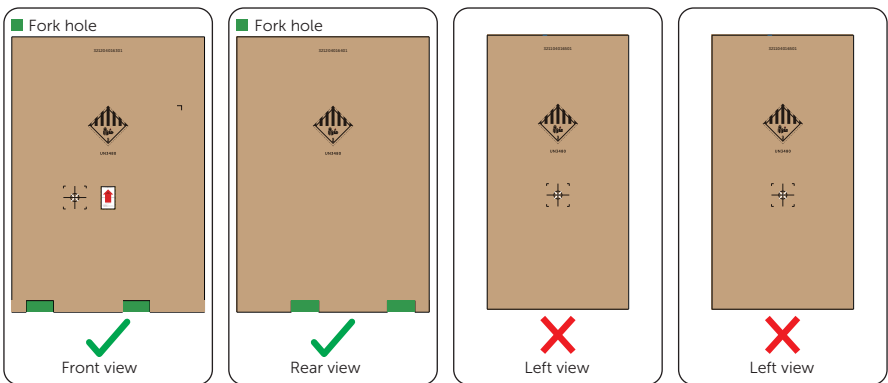


## Installation Foundation Requirement

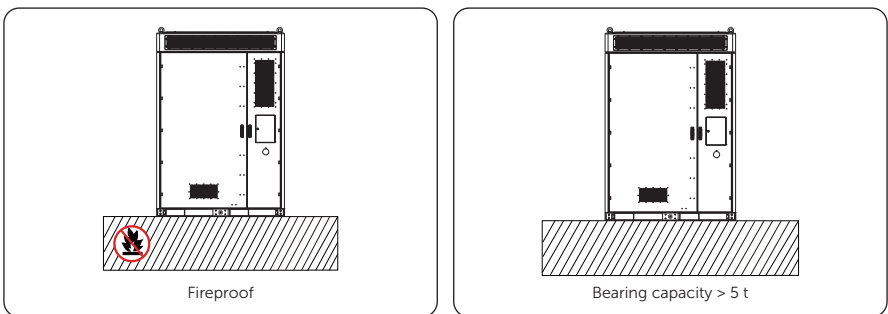


## Angle supports installed at front and rear sides

Unit: mm


- Installation position for eye bolt
- Fork position,
- Angle support
- Foundation

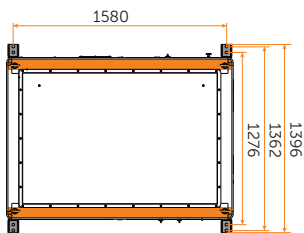


Plan view

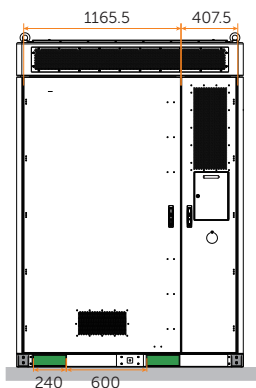


Front view

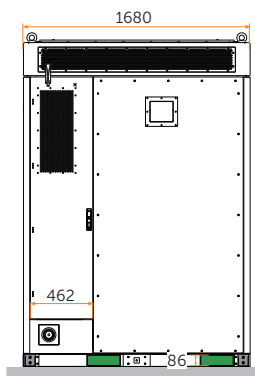

Rear view

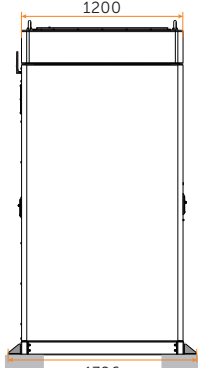



Left view

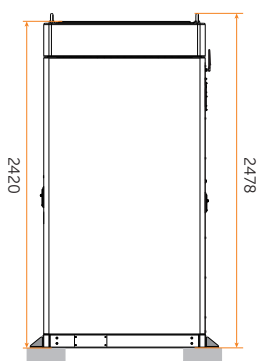

Right view

Unit: mm

■ Foundation




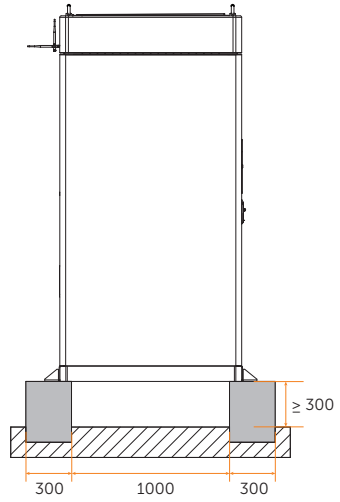
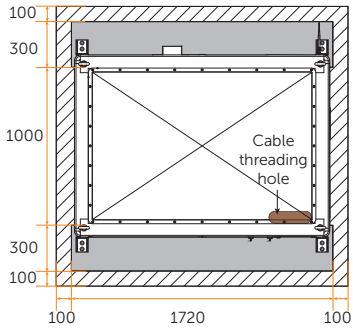





## Angle supports installed at left and right sides


Unit: mm

- Installation position for eye bolt
- Fork position,
- Angle support
- Foundation

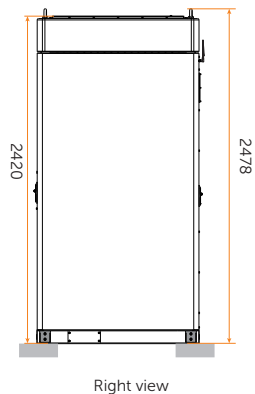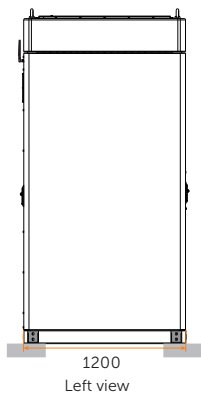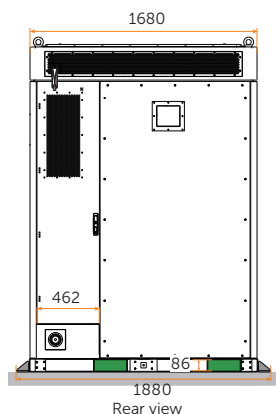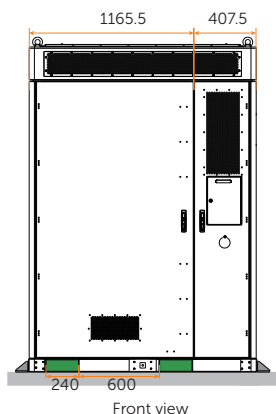

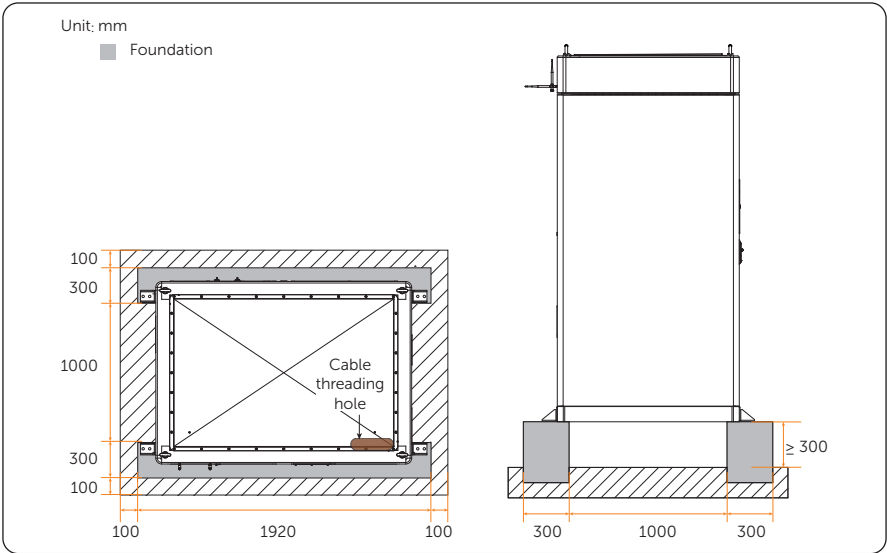





### Dimensions of angle support

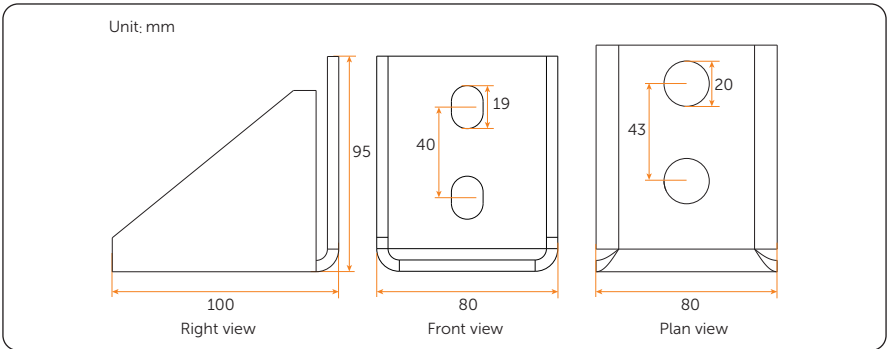



















### Installation Space

The device support the following installation options:

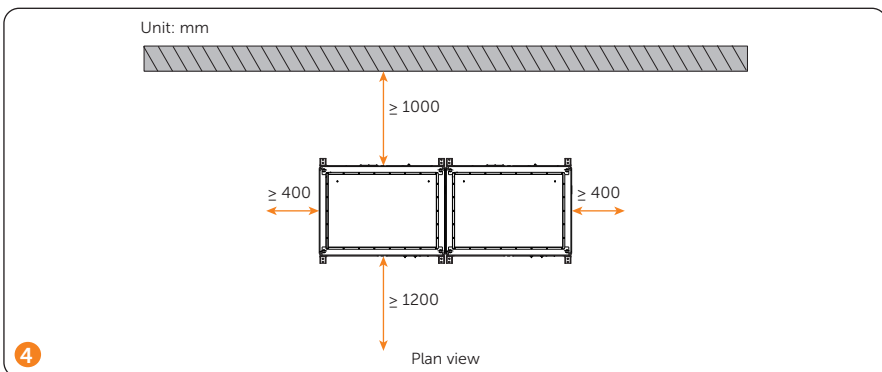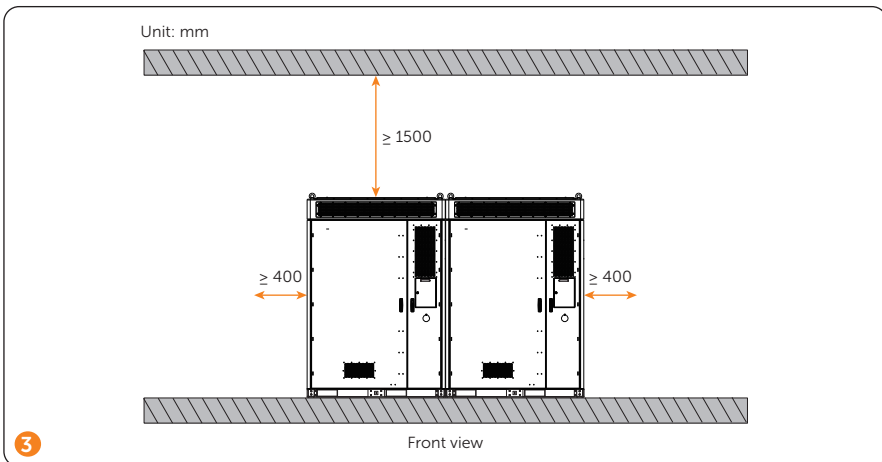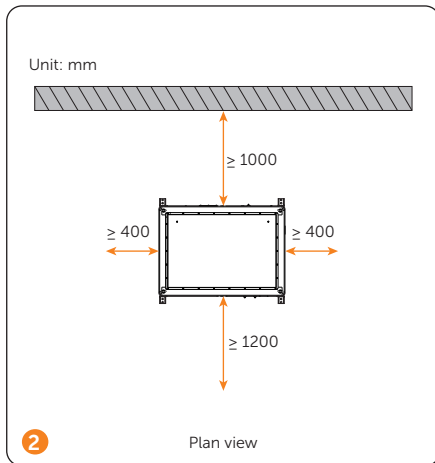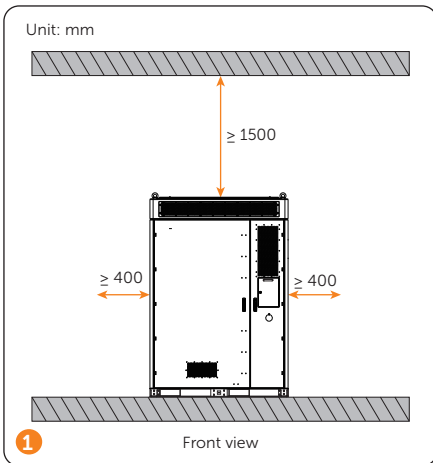


1. A single cabinet;
2. Multiple cabinets:
  - a. install separately (For the detailed installation space, refer to Figure 1 and 2);
  - b. install together (Refer to Figure 3 and 4).



## Installation Tools



## Additionally Required Materials

No.	Required Material	Type	Conductor Cross-section
1	Grounding plate 	Galvanized iron plate	Width: 40 mm Depth: 4mm
2	Grid wire 	Five-core copper cable (copper wire)	$50 \text{ mm}^2 * 4 + 35 \text{ mm}^2 * 1$
3	Additional PE wire 	Conventional yellow and green wire	$50 \text{ mm}^2$

## Mechanical Installation



### WARNING!




- Do not destroy the cabinet's anti-corrosion coating during the process of installation.

### NOTICE!

- If the eye bolts are required to be installed based on the actual situation, please strictly follow the steps below.

## Installation of Eye Bolt


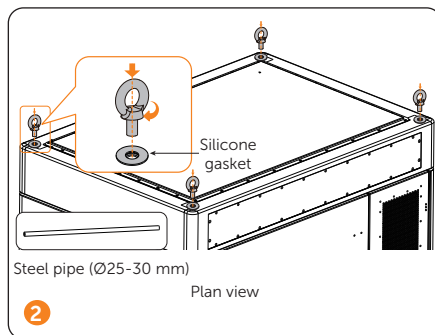
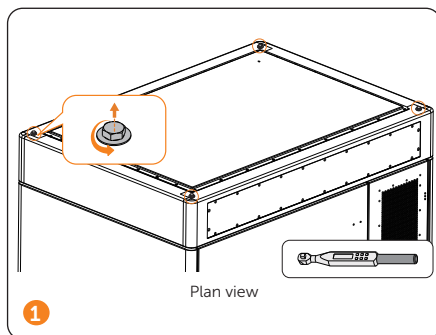


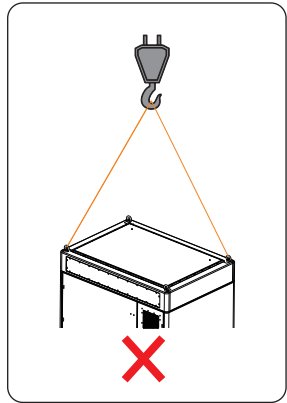
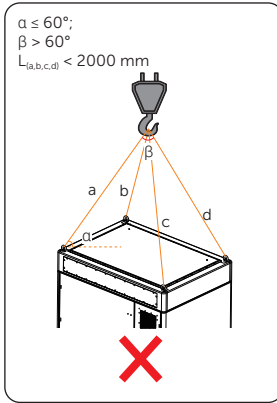
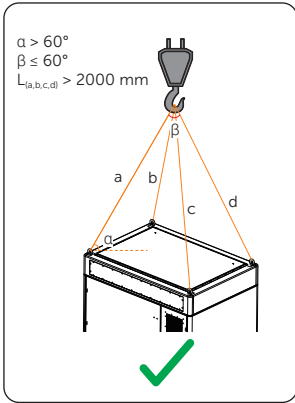


### NOTICE!

- Put the silicone gaskets in place before inserting the eye bolts.




### Installation of Angle support and Cover

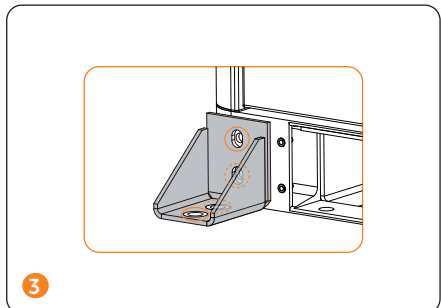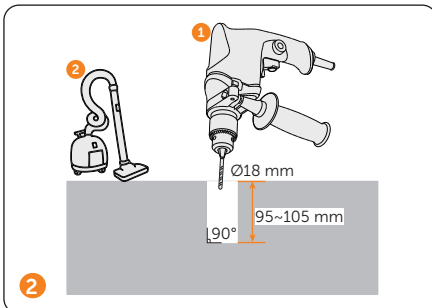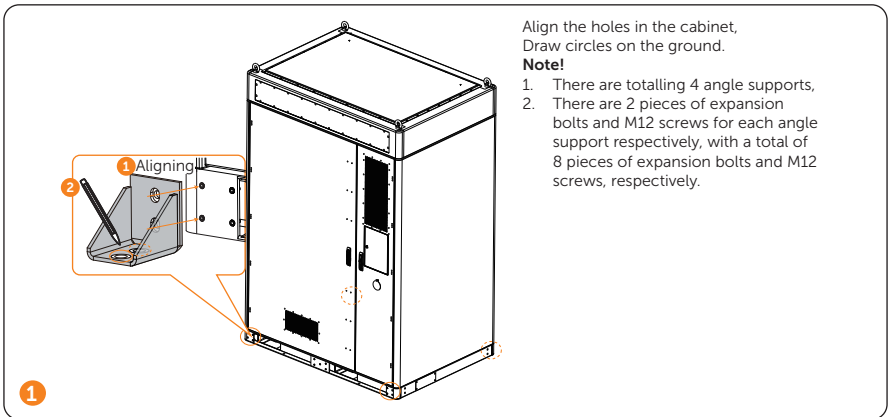






4

**Note:** Reinstall the angle supports, ensuring that the screw holes on the angle support align with the screw holes on the cabinet and foundation.



5

Each cover has 4 screws, with a total of 4 covers.




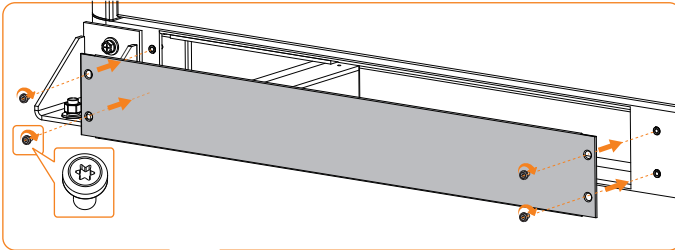


6

## NOTICE!


- The above-mentioned installation steps also apply to the angle supports, which are installed on both the left and right sides.

## Installation of Antenna

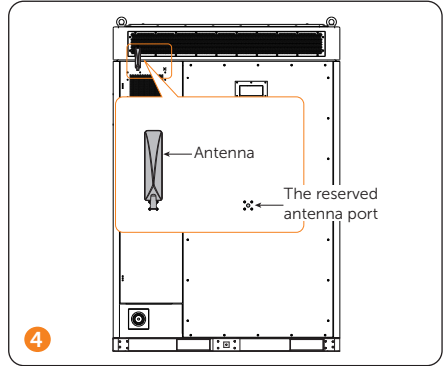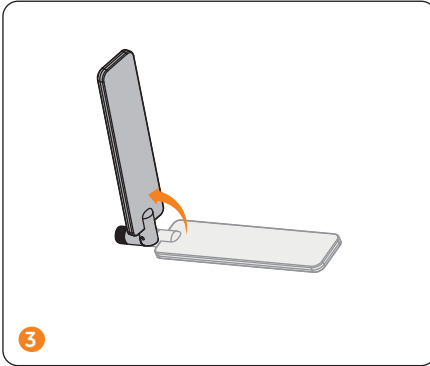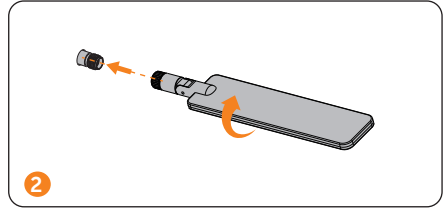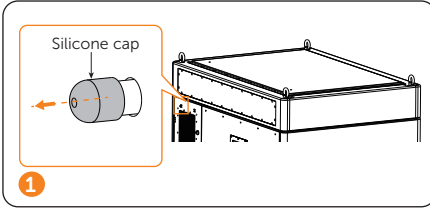

## Wiring

### Parts that Need Wiring

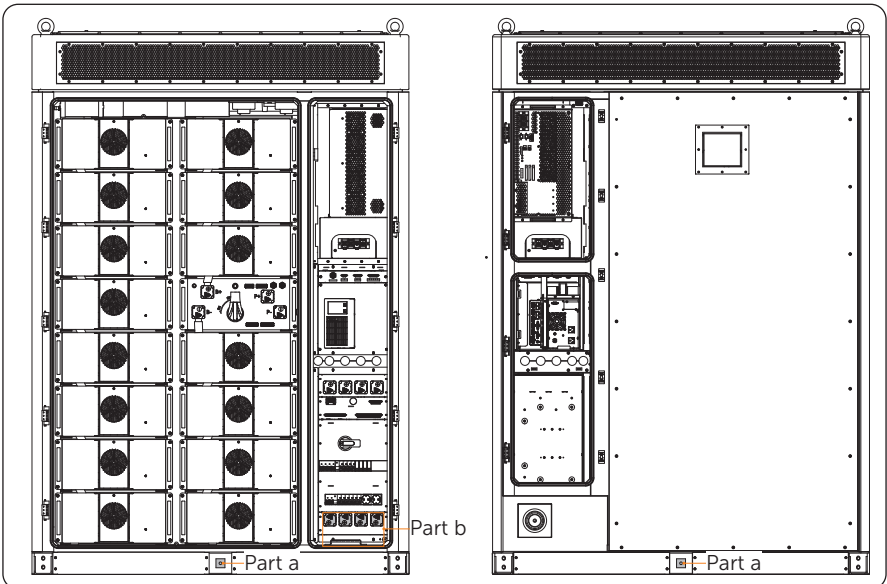




## NOTICE!

- Before wiring, operators are required to learn which parts need to be conducted wiring. For details, see the following figure.



### Grounding Plate Connection



Regarding the grounding plate connection, namely Part a in "[Parts that Need Wiring](#)", either connection area is available, please strictly follow the steps below.

In the case of grounding plate connection:

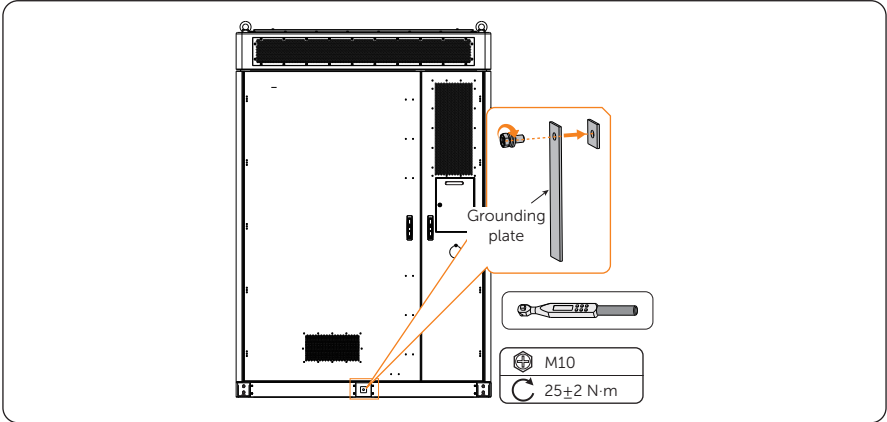


In the case of PE connection:

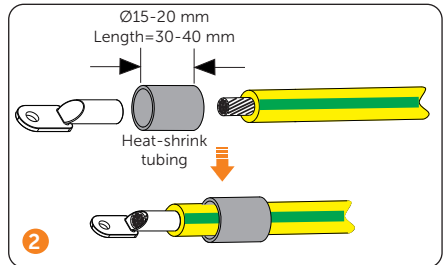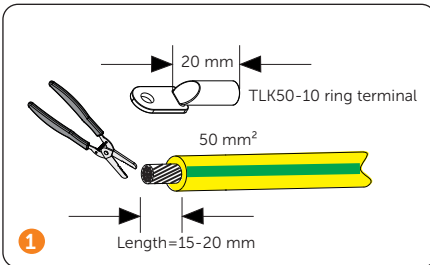


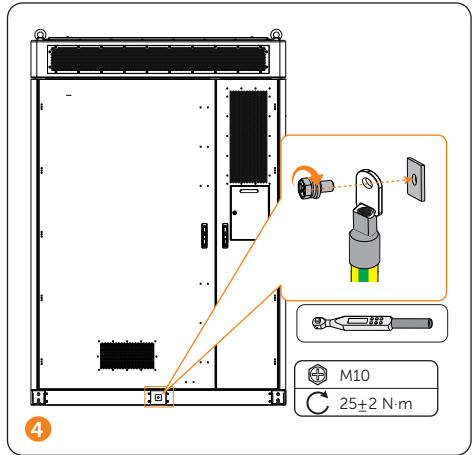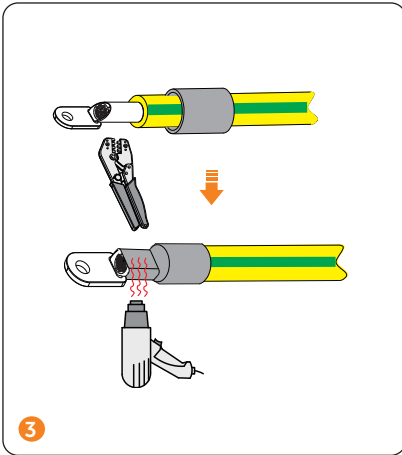


### Grid Connection

Regarding the grid connection, namely Part b in [“Parts that Need Wiring”](#), please strictly follow the steps below.

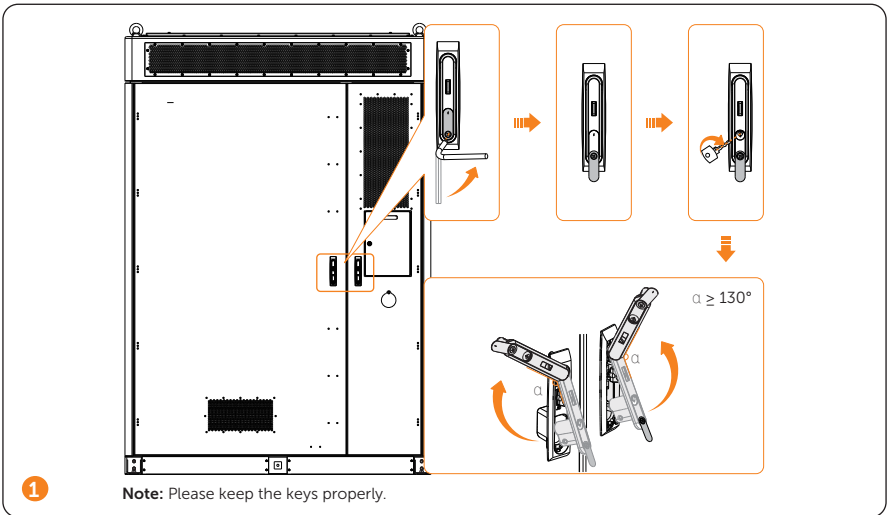

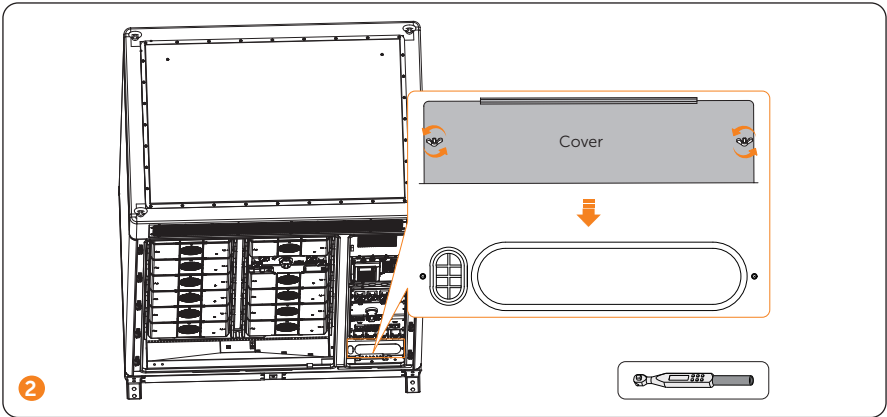

Cable	Cross-sectional area	Strip length
Five-core cable	/	220-250 mm
L1/L2/L3/N	50 mm <sup>2</sup>	18-24 mm
PE	35 mm <sup>2</sup>	14-20 mm

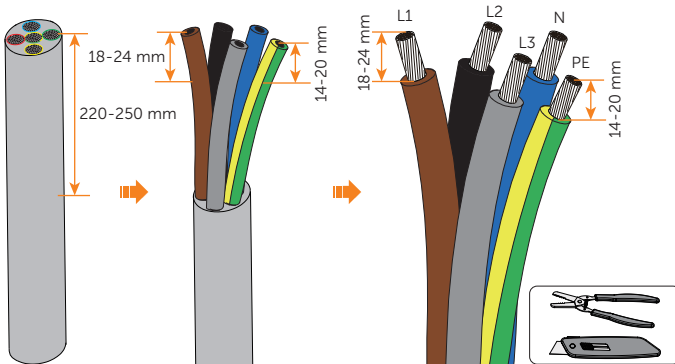

**Note:**

1. It's important to give the power cable a health check before stripping it.
2. It's necessary to use controlled motion to strip the insulation down the wire, to prevent damage to the wires.
3. Make sure that the insulation layer has been stripped to a sufficient length so that the center conductor is fully exposed without any damage or nicks. In addition, make sure that no extra insulation remains beyond the connector once it's crimped on.

3

(Ø15-20 mm)  
40-50 mm

L1  
L2  
L3  
N  
PE

TLK50-8 ring terminal  
TLK35-8 ring terminal

(Ø10-14 mm)  
30-40 mm

Cable	Heat shrink tubing	
	Diameter	Length
L1/L2/L3/N:	Ø15-20 mm	40-50 mm
PE:	Ø10-14 mm	30-40 mm

4

Since the procedure for installing a terminal is same, take the L1 copper wire, for instance.

Hydraulic wire crimper

**Note!**

1. Do not damage the conductor insulation while crimping.
2. Do not place the conductor insulation into the terminal.

5

L1  
L2  
L3  
N  
PE

**Note:** Move the heat gun back and forth slowly to distribute the heat evenly across the surface of heat shrink tubing.

6

There are two options (a and b) for pulling through cables.

- In the case of **option a**, unscrew hexalobular socket screws to remove cover. See following figure.

- In the case of **option b**, pull cable directly through the bottom of the cabinet.





Right view

7



To thread communication cable (if the number of cabinets is  $\geq 2$ )

To thread Grid wire

8

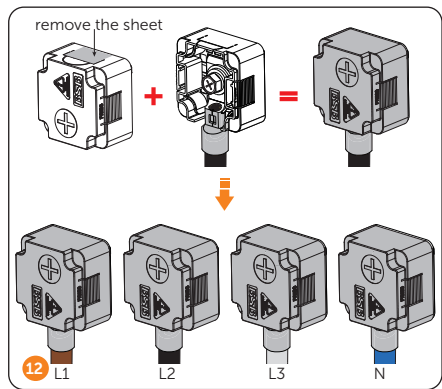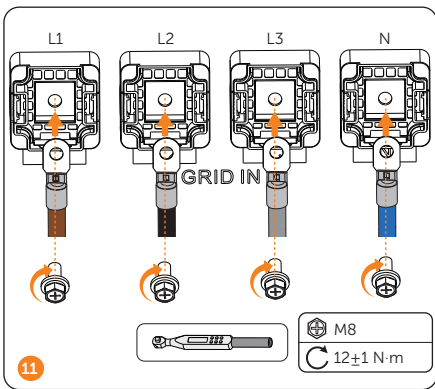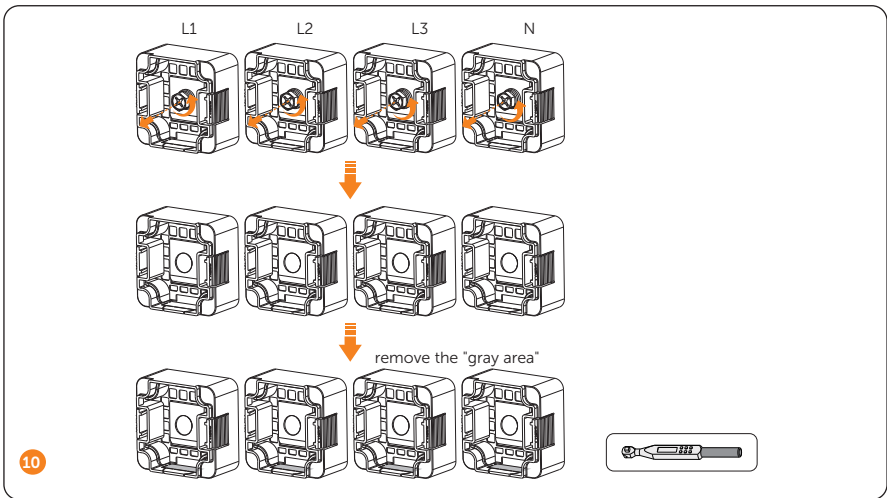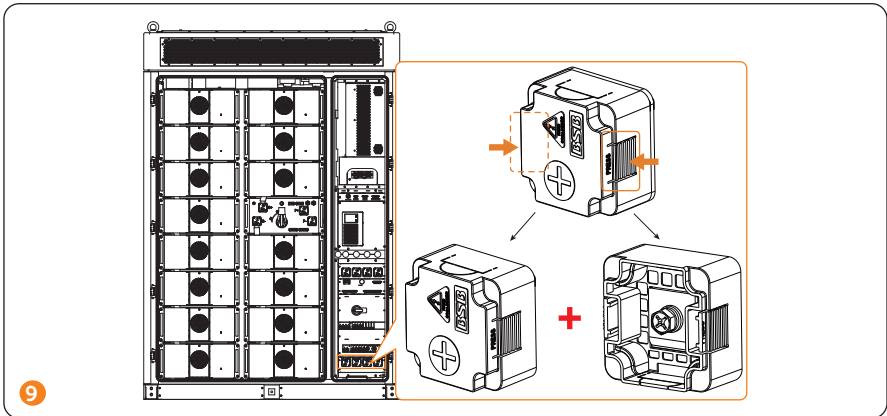

User can choose a or b to connect the grounding cable.

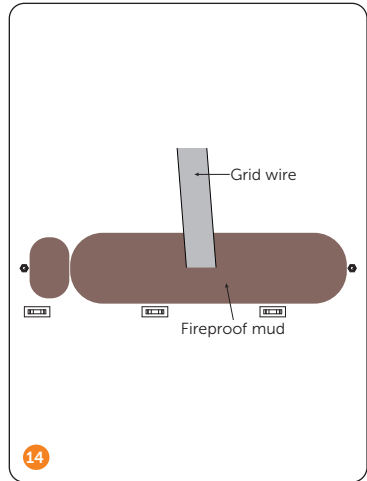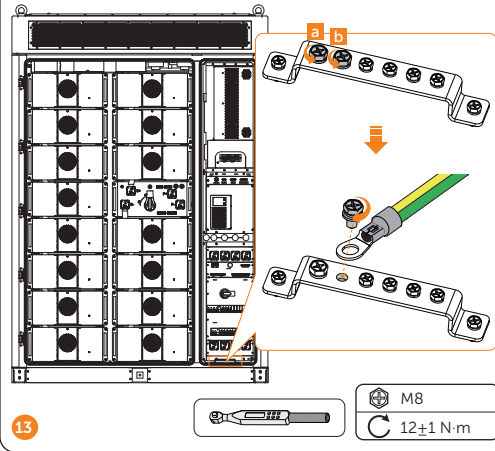

### NOTICE!

- Must clean the materials, such as metal parts, screws, etc., in the cabinet after finishing wiring.
- It is recommended to seal off the gap between foundations after finishing wiring.

### NOTICE!

#### Notice for fireproofing mud:

- Take out the fireproof mud delivered with the cabinet and knead it into a ball shape. In the case of the low temperature, place it into warm water, of which the temperature range is between 40°C and 70 °C, with its package until it is soft.
- Clean the area around the cable threading hole before sealing it.
- The fireproof mud should be evenly spread, embedded, or filled in the cable threading hole. If such a hole is too large, a fireproofing board can be placed to enhance fire protection before using the mud.
- The fireproof mud needs to be cured after sealing the cable threading hole. Prevent water from entering and colliding during curing.


## Power on the System

### Checking before Power-on







No.	Item	Checklist
1	System	<ul style="list-style-type: none"><li>• Check the various components and equipment of the system to ensure that the equipment is intact and the labels are clear and complete.</li></ul>
2	Electrical Inspection	<ul style="list-style-type: none"><li>• Ensure that the power lines and communication cables from the distribution box to the grid are connected correctly and securely;</li><li>• The grounding connection is correct and reliable;</li><li>• Inspect other connections to ensure that the electrical connections meet the standard requirements.</li></ul>
3	Unused Ports	<ul style="list-style-type: none"><li>• Place waterproof caps on unused ports</li></ul>
4	Screws	<ul style="list-style-type: none"><li>• Ensure all screws are tightened.</li></ul>
5	Safety Inspection	<ul style="list-style-type: none"><li>• Inspect the safety environment around the system to ensure there are no open flames, flammable materials, or other safety hazards. Keep pathways clear for evacuation and rescue in case of emergencies.</li></ul>

### Power-on the system


Regarding the detailed location of the modules in the cabinet, see following figure.

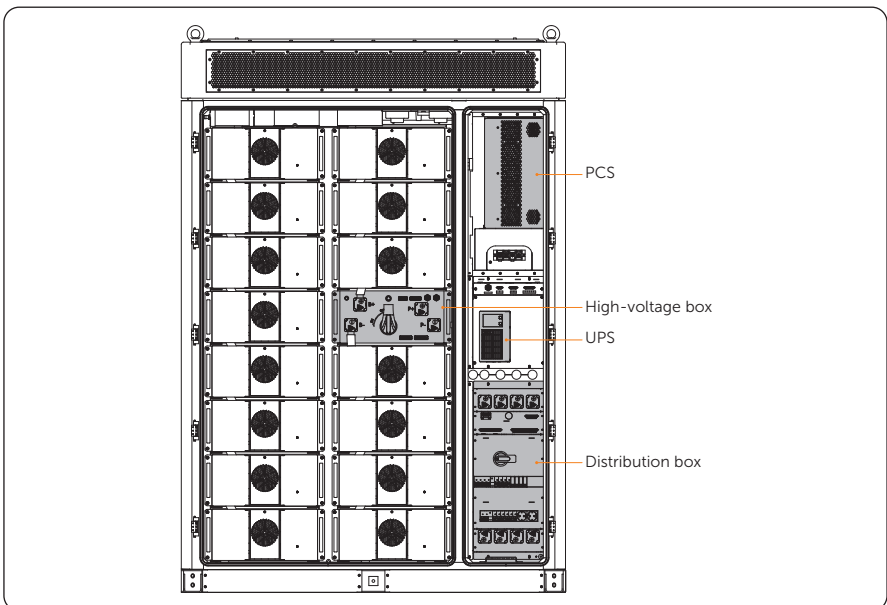

For the detailed steps, see following figures.

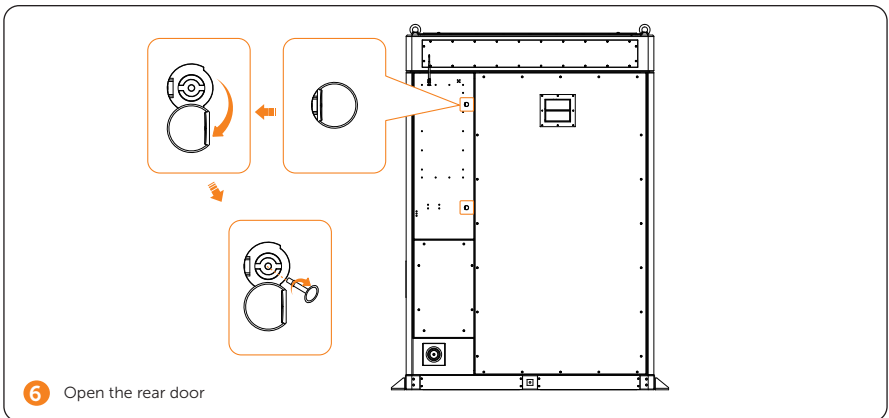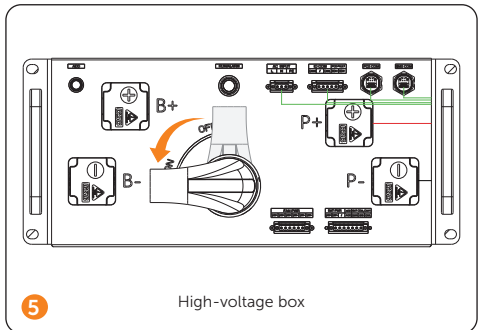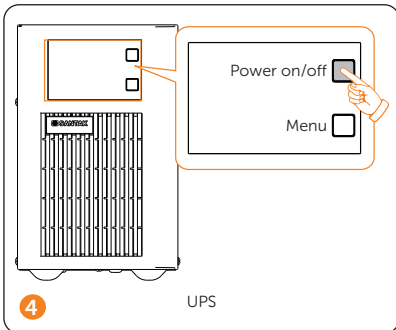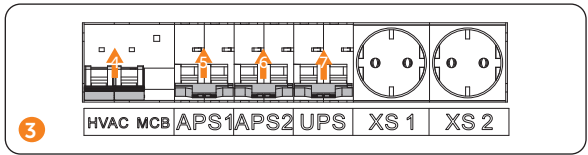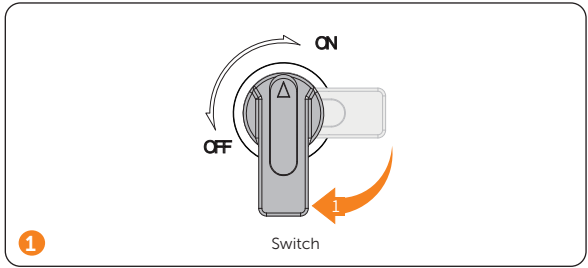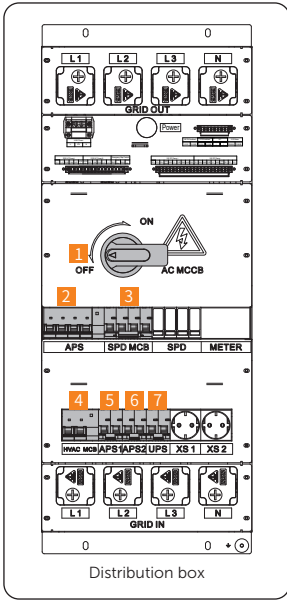




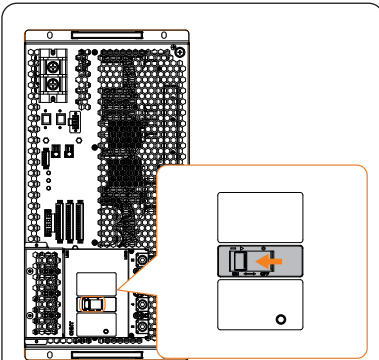

**Note:** After starting up the PCS, lock the rear door.

7

PCS

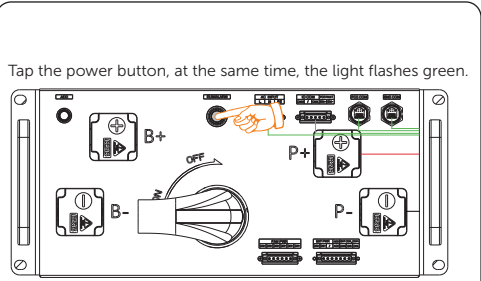


Tap the power button, at the same time, the light flashes green.

8

High Voltage Box


**Note:** Please properly keep the keys.

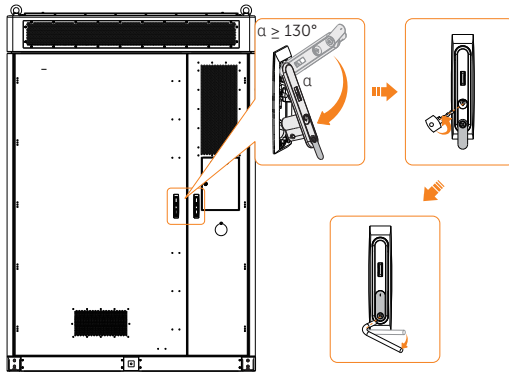

9


### EMS Log in

- Local Screen Login

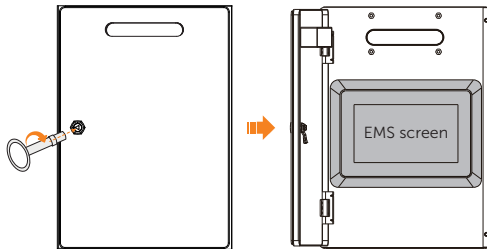

1

Screen door

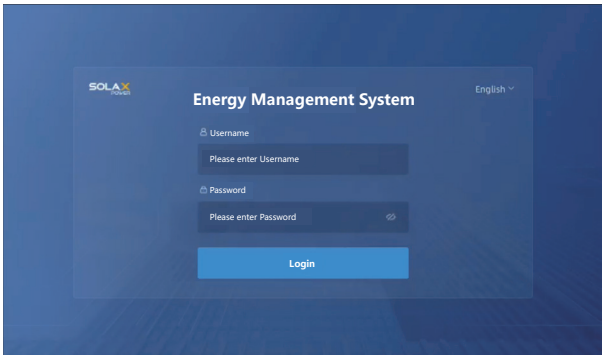

**Energy Management System** English

Username  
Please enter Username

Password  
Please enter Password


Login

Username: user  
Password: 123456

- Webpage Login

Connect the computer to NET2 of EMS1000 with a network cable, or connect the computer to EMS1000 hotspot named WiFi\_SN, and then go to the defined IP address based on the connection mode.

- For wired connection: 192.168.11.10
- For hotspot connection: 192.168.10.10

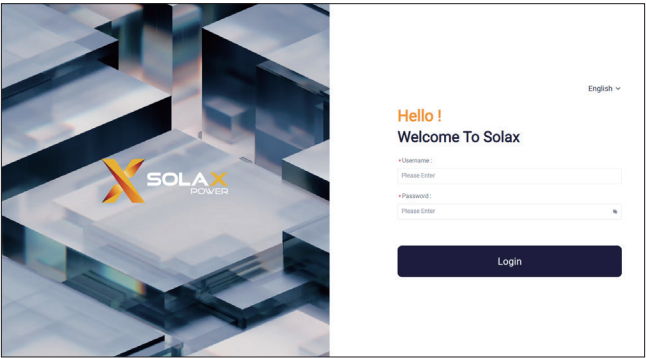

English

**Hello !**  
Welcome To Solax

Username:  
Please Enter

Password:  
Please Enter



Login







Username: user  
Password: 123456


## Power off the System

There are two circumstances: 1. Normal power off; 2. Emergency power off.


### Normal Power Off

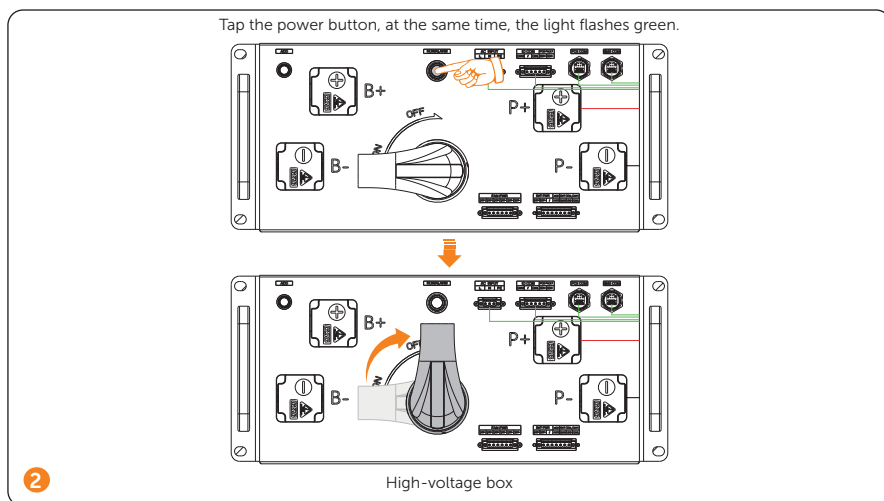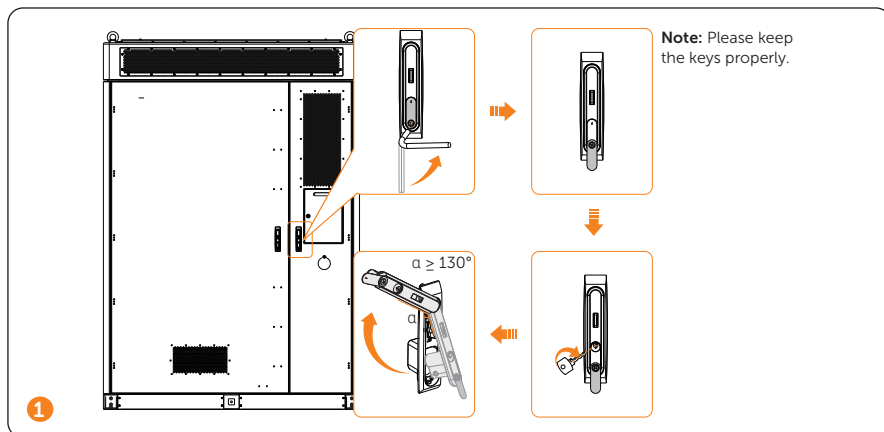

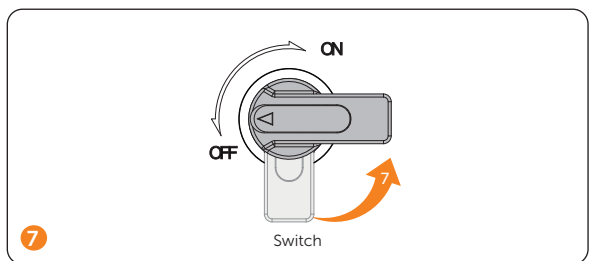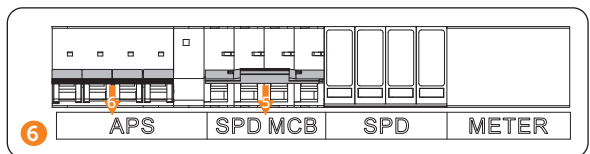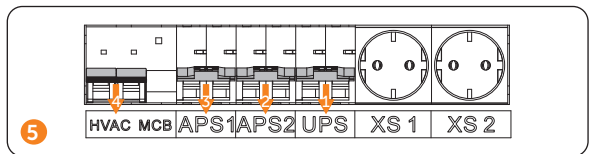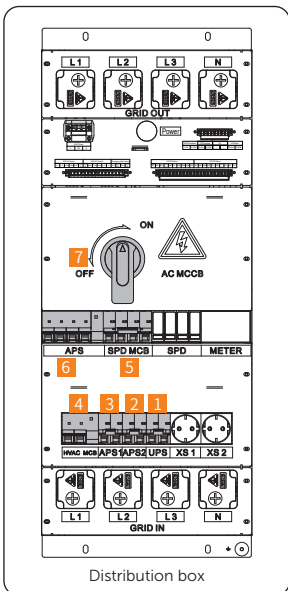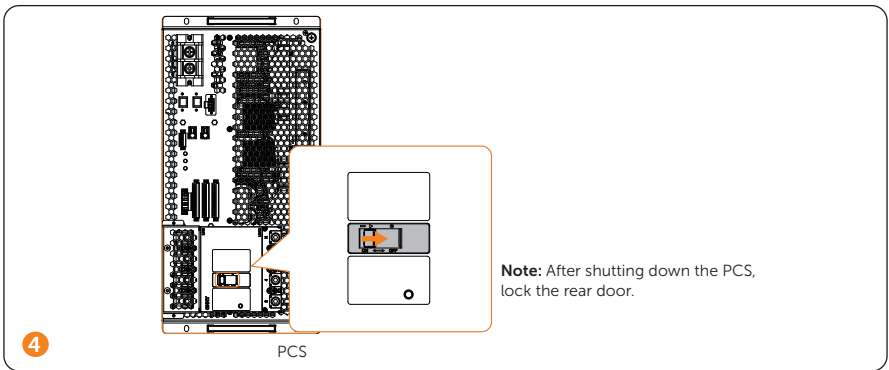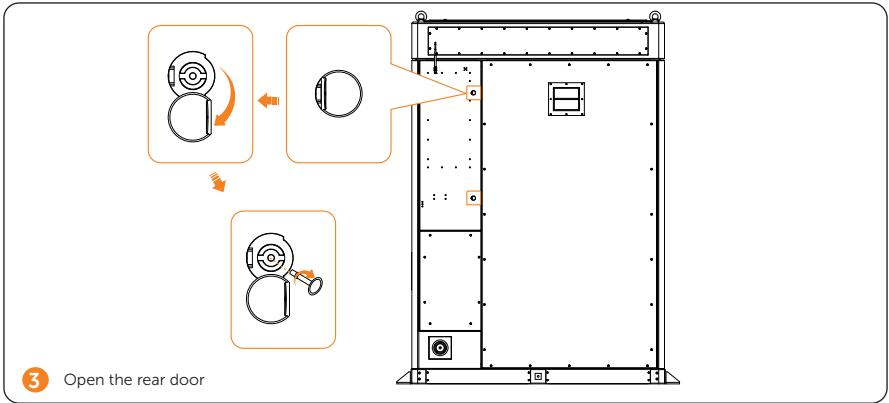

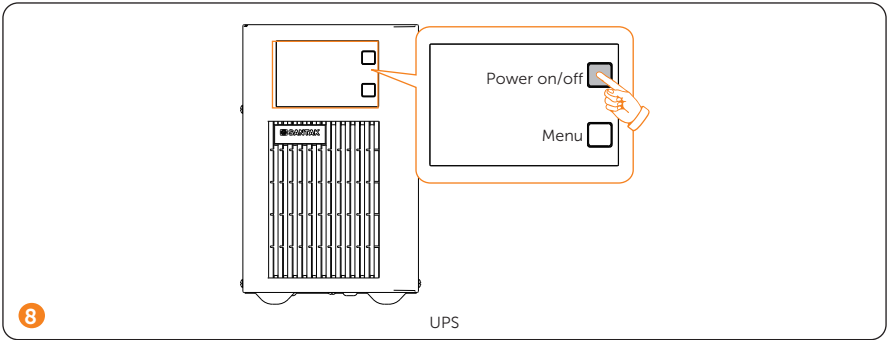

### Emergency Power Off

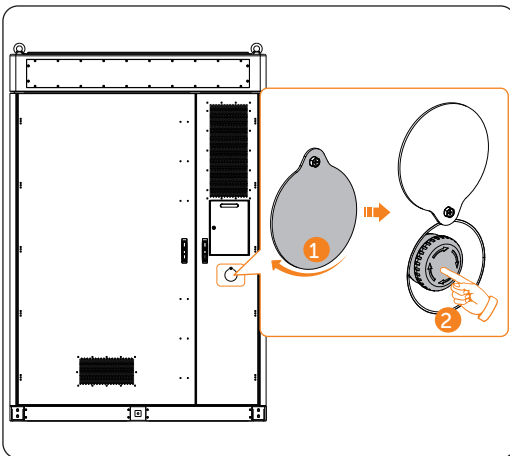

#### ! WARNING!


- Do not press the emergency stop button except for emergencies.




#### NOTICE!

- If it has been pressed, the emergency stop button must be reset before starting the equipment. The reset steps are shown as follows:
  - Rotate the cover;
  - Rotate the button according to the arrow direction shown on the button. Then the button will spring back to its original position.


## LED Indicators
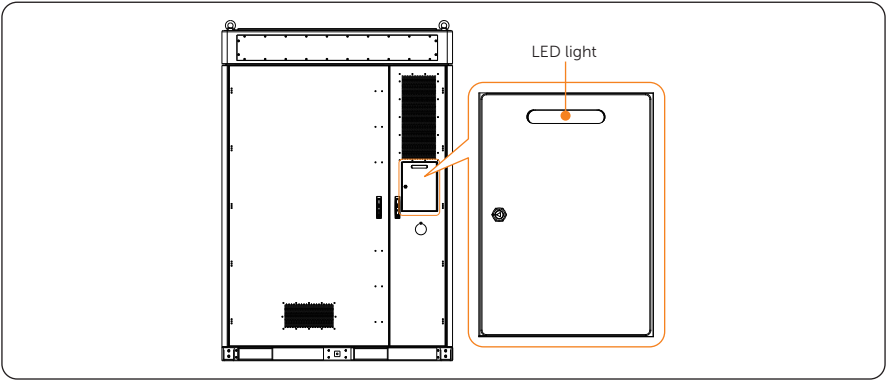
### Cabinet's LED Light




Status		Description
Solid yellow light		In standby
Solid green light		In operation
Solid red light		System failure

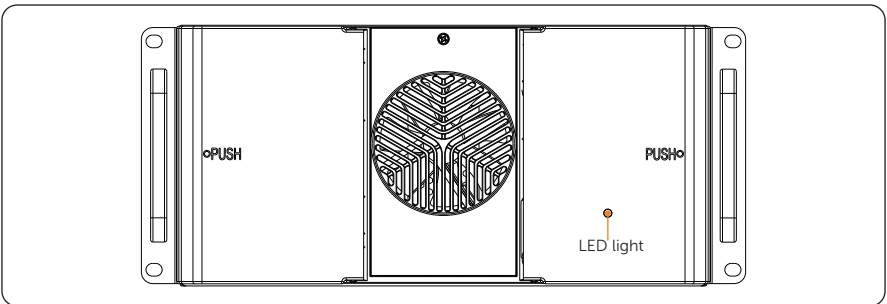


### Battery Pack's LED Light




Status		Description
Flashing green light		In operation
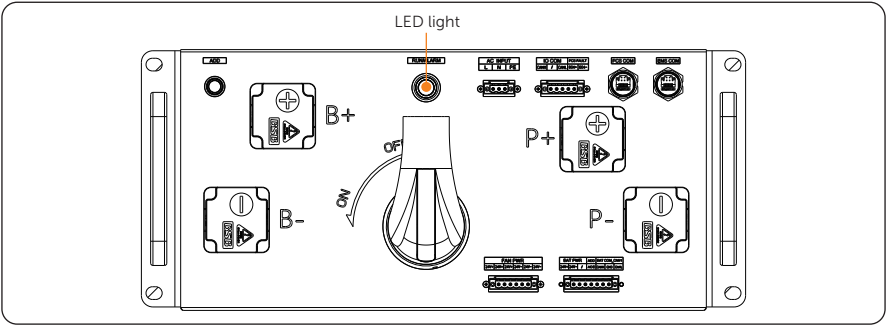
## High-voltage Box's LED Light




Status	Description
Flashing green light 	Rely is off.
Solid green light 	In operation
Solid red light 	System failure



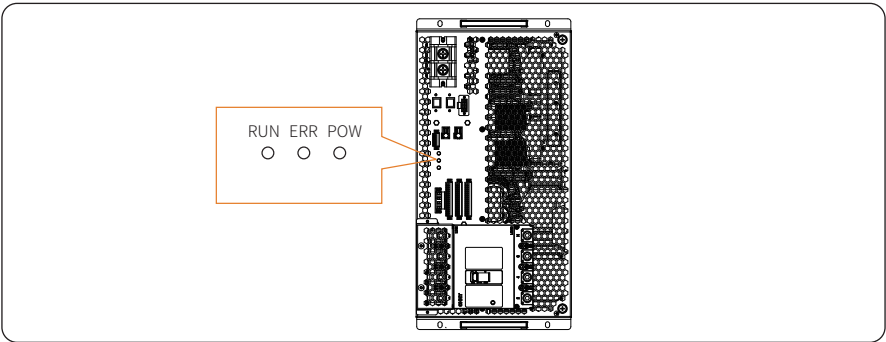



## PCS's LED Light

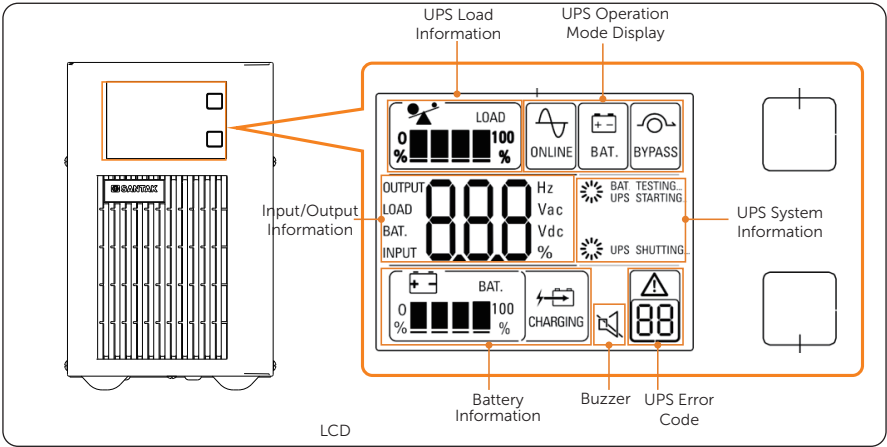

Status	Description	
ERR      Steady	Operational fault	
RUN      Steady	DC Input	
POW	Steady	Running normally
	Flashing	Standby

## UPS's LCD



Display	Description
Input/Output Information	It indicates input and output voltage/frequency value, which are displayed alternately. It also indicate load per cent and battery voltage value.
UPS Operation Mode Display	It indicates UPS operating mode.
Load information	Indicates the load level. Each grid represents the level of 25%. If UPS is overloaded, the icon  would flash once time per second.
Battery Information	Indicates the battery capacity. Every grid represents the capacity of 25%. If the battery charger is running, the icon  would show.
Buzzer	The icon will be displayed after panel key operation or serial command mute. 
UPS Error Code	The icon will be displayed when the buzzer sounds normally.  Indicates the UPS is in Fault mode or has some warnings. Indicates Fault kind or Warning kind, several warning kinds at the same time could be displayed alternately. The icon  would flash when having warnings. The icon  would show continuous when in Fault mode.
UPS System Information	Indicates UPS system information



## Technical Data

### TRENE-P100B215

- Cabinet (AC Side)

Model	TRENE-P100B215I
Rated AC power [kW]	100
Rated AC current [A]	144.4
Max. AC apparent power [kVA]	110
Nominal grid voltage [V]	400 (-20% ~ +15%)
Nominal grid frequency [Hz]	50 / 60
Adjustable power factor range	0.99 leading ~ 0.99 lagging
THDi (Rated power) [%]	< 3
Max. efficiency [%]	98%
DC anticipated short circuit current [A]	8500
AC anticipated short circuit current [A]	8000
AC transient short-circuit current [A]	< 350 (Duration: 4 ms)

- Battery Parameter

Model	TRENE-P100B215I
Battery type	LiFePO4
Battery capacity [kWh]	215
Rated battery voltage [V]	768
Battery voltage range [V]	630 ~ 876
Depth of discharge [%]	90
Rated charge/discharge current [A]	140

- General Parameter




Model	TRENE-P100B215I
Dimension (WxHxD) [mm]	1680 × 2420 × 1200
Weight [kg]	2800
Operating temperature range [°C]	-30 ~ 50
Relative humidity (Non-condensing) [%]	0 ~ 95
Altitude [m]	3000
Cooling concept	Smart air cooling
Ingress protection	IP55
Fire protection	Aerosol (Optional: Novec1230) / Water
Topology	Non-isolated
Certificates	IEC61000, IEC62477-1, UN38.3, GB/T36276, GB/T 34131

### TRENE-B215



Product Name	TRENE-B215
Battery Designation	IFpP74/175/208[(16S)15S]M/-20+50/95
Battery Type	LiFePO4
Rated Capacity [Ah]	280
Cell Manufacturer	A
Rated DC Voltage [d.c.V]	768
Rated Energy [kWh]	215
DC Voltage Range [d.c.V]	636 ~ 876
Max. Charge/Discharge Current [A]	140
Conditional Short-circuit Current (I <sub>cc</sub> ) [A]	< 10000
Output Short-circuit Current [A]	4500 (Duration: 1.3 ms)
Charge Temperature [°C]	0 ~ 50
Discharge Temperature [°C]	-20 ~ 50
Storage Temperature [°C]	50 ~ 60 (3 months); 30 ~ 50 (6 months); -20 ~ 30 (12 months)
Altitude [m]	< 3000
Ingress Protection	IP55
Protection Class	I
Certificates	IEC 62619, IEC 63056

# Contact Information




## UNITED KINGDOM

 Unit C-D Riversdale House, Riversdale  
Road, Atherstone, CV9 1FA  
 +44 (0) 2476 586 998  
 [service.uk@solaxpower.com](mailto:service.uk@solaxpower.com)

## TURKEY

 Fevzi Çakmak mah. aslım cd. no 88 A  
Karatay / Konya / Türkiye  
 [service.tr@solaxpower.com](mailto:service.tr@solaxpower.com)



## USA

 3780 Kilroy Airport Way, Suite 200, Long  
Beach, CA, US 90806  
 +1 (408) 690 9464  
 [info@solaxpower.com](mailto:info@solaxpower.com)


## POLAND

 WARSAW AL. JANA P. II 27. POST  
 +48 662 430 292  
 [service.pl@solaxpower.com](mailto:service.pl@solaxpower.com)




## ITALY

 +39 011 19800998  
 [support@solaxpower.it](mailto:support@solaxpower.it)





## PAKISTAN

 [service.pk@solaxpower.com](mailto:service.pk@solaxpower.com)





## AUSTRALIA

 21 Nicholas Dr, Dandenong South VIC 3175  
 +61 1300 476 529  
 [service@solaxpower.com.au](mailto:service@solaxpower.com.au)



## GERMANY

 Am Tullnaupark 8, 90402 Nürnberg,  
Germany  
 +49 (0) 6142 4091 664  
 [service.eu@solaxpower.com](mailto:service.eu@solaxpower.com)  
 [service.dach@solaxpower.com](mailto:service.dach@solaxpower.com)



## NETHERLANDS

 Twekkeler-Es 15 7547 ST Enschede  
 +31 (0) 8527 37932  
 [service.eu@solaxpower.com](mailto:service.eu@solaxpower.com)  
 [service.bnl@solaxpower.com](mailto:service.bnl@solaxpower.com)


## SPAIN

 +34 9373 79607  
 [tecnico@solaxpower.com](mailto:tecnico@solaxpower.com)

## BRAZIL

 +55 (34) 9667 0319  
 [info@solaxpower.com](mailto:info@solaxpower.com)

## SOUTH AFRICA

 [service.za@solaxpower.com](mailto:service.za@solaxpower.com)



# Warranty Registration Form



## For Customer (Compulsory)

Name \_\_\_\_\_ Country \_\_\_\_\_  
Phone Number \_\_\_\_\_ Email \_\_\_\_\_  
Address \_\_\_\_\_  
State \_\_\_\_\_ Zip Code \_\_\_\_\_  
Product Serial Number \_\_\_\_\_  
Date of Commissioning \_\_\_\_\_  
Installation Company Name \_\_\_\_\_  
Installer Name \_\_\_\_\_ Electrician License No. \_\_\_\_\_

## For Installer

### Module ( If Any )

Module Brand \_\_\_\_\_  
Module Size(W) \_\_\_\_\_  
Number of String \_\_\_\_\_ Number of Panel Per String \_\_\_\_\_

### Battery ( If Any )

Battery Type \_\_\_\_\_  
Brand \_\_\_\_\_  
Number of Battery Attached \_\_\_\_\_  
Date of Delivery \_\_\_\_\_ Signature \_\_\_\_\_

Please visit our warranty website: <https://www.solaxcloud.com/#/warranty> or use your mobile phone to scan the QR code to complete the online warranty registration.



For more detailed warranty terms, please visit SolaX official website: [www.solaxpower.com](http://www.solaxpower.com) to check it.







## **SolaX Power Network Technology (Zhejiang) Co., Ltd.**

Add.: No. 278, Shizhu Road, Chengnan Sub-district, Tonglu County,  
Hangzhou, Zhejiang, China  
E-mail: [info@solaxpower.com](mailto:info@solaxpower.com)

